

S7-300 PLC PROFINET LUC-PNB IO

LUC-PNB S7-300PLC IO PROFINET .xml LUC-PNB IO LUC-PNB IO

- STEP 7 V5.5 SP2


- LUC-PNB IO GSDML-V2.35-LATCOS-LUC\_PN-20230320

1. S7-300PLC LUC-PNB IO

2. PLC LUC-PNB IO X1P1 IO  
X1P2

1.

STEP7

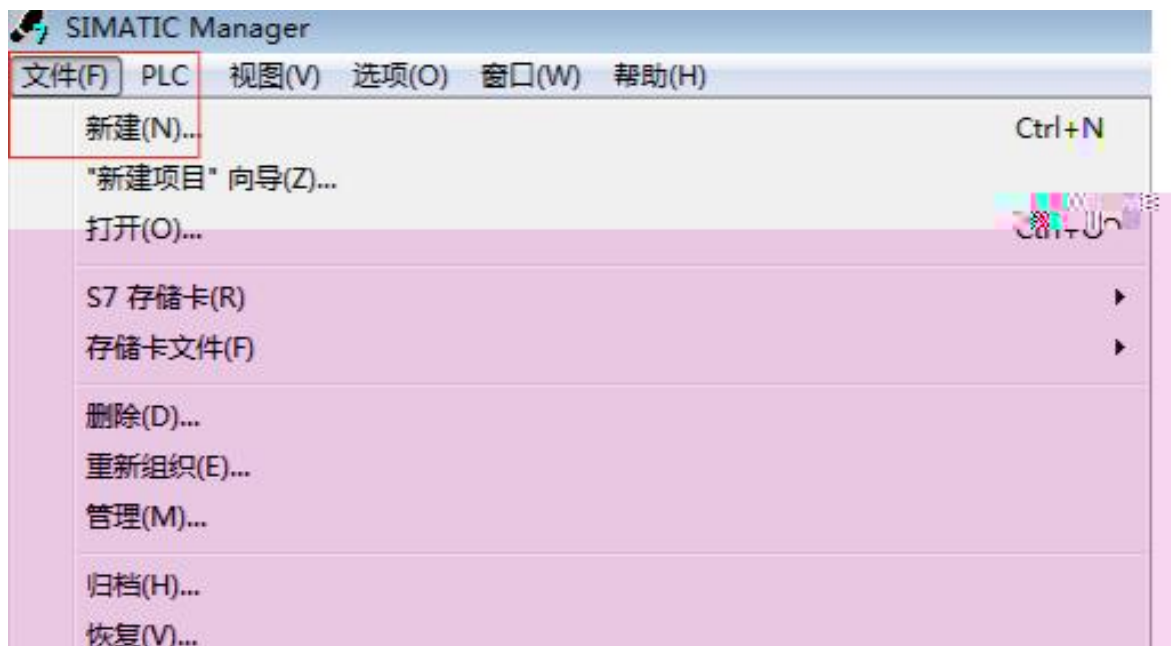



2.

SIMATIC 300 CPU 315-2DP/PN



3.


"HW Config"

IP

CPU


PN-IO

Ethernet(1)

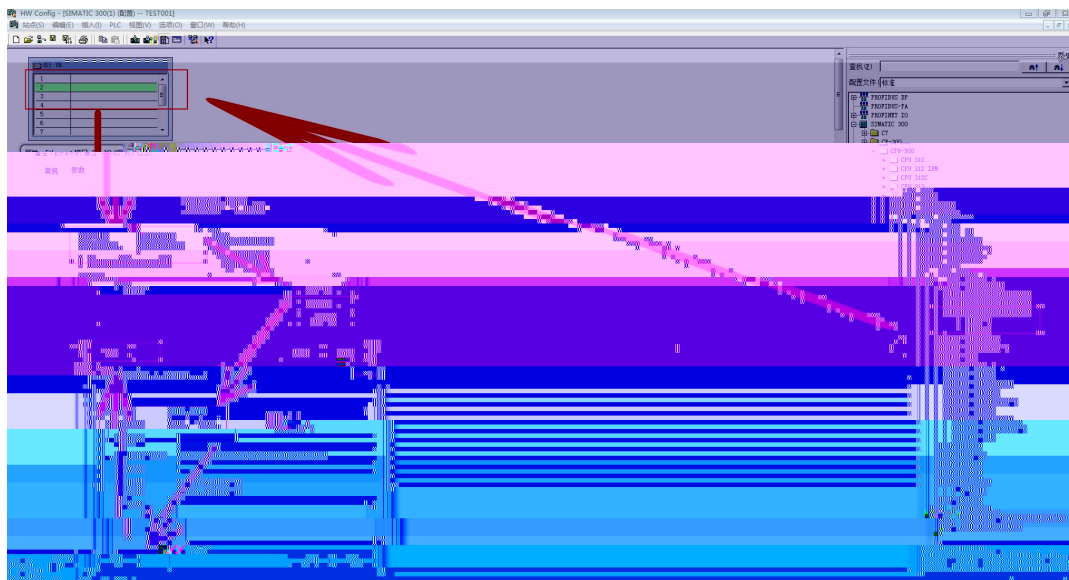


4. GSD

" " " GSD ..."

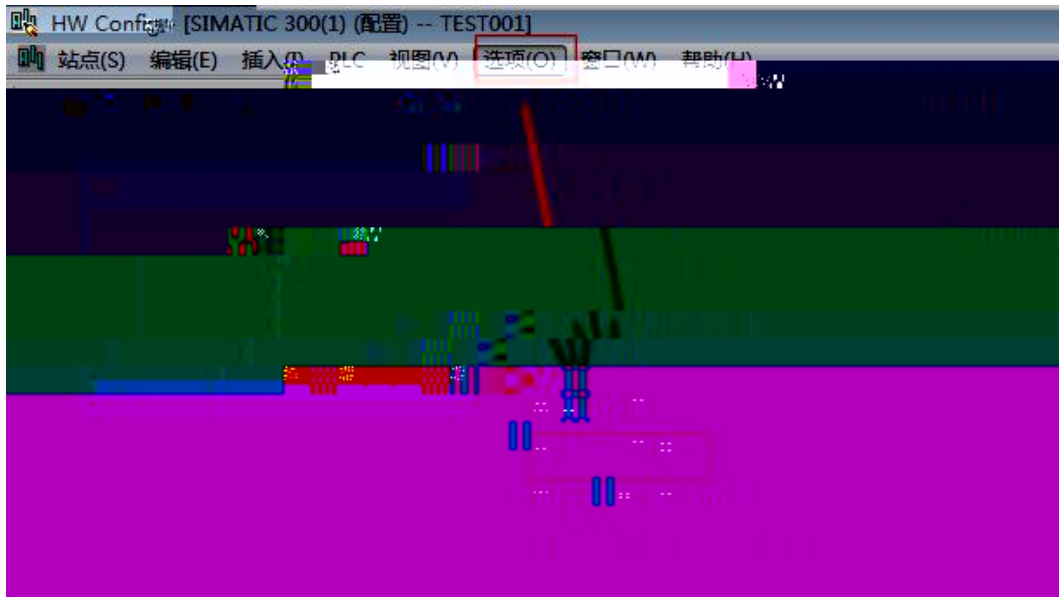

" " .XML " "

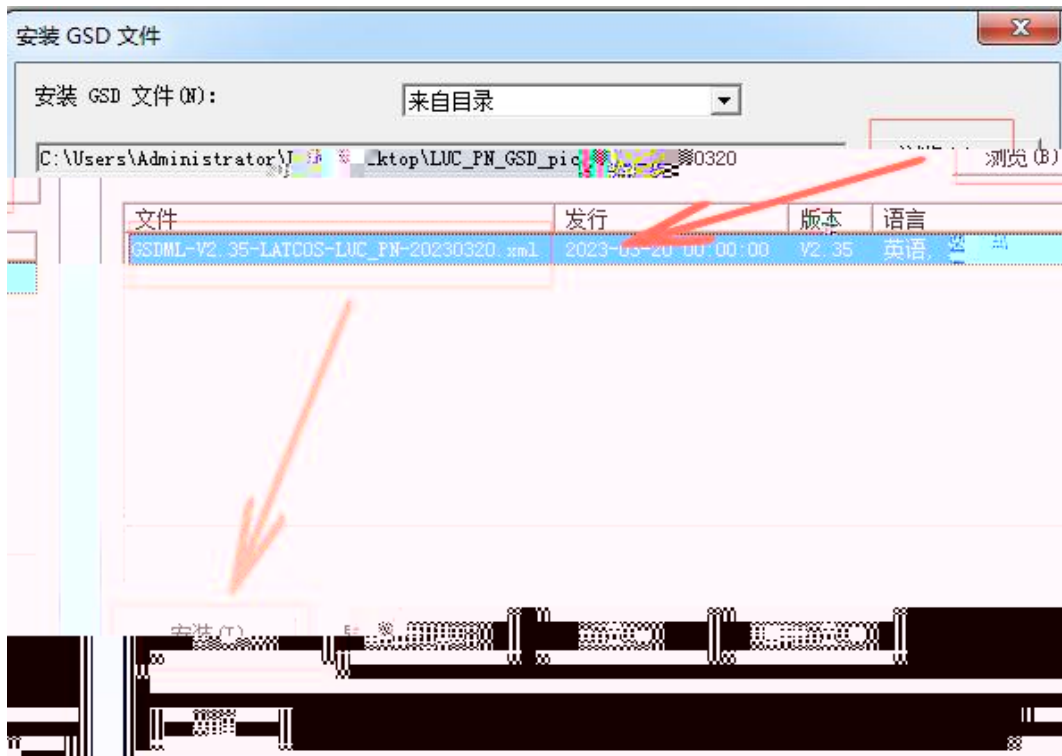

5.

Ethernet(1)

IO



IO



PROFIBUS

PROFINET IO LUC-PN

Ethernet(1)


IP

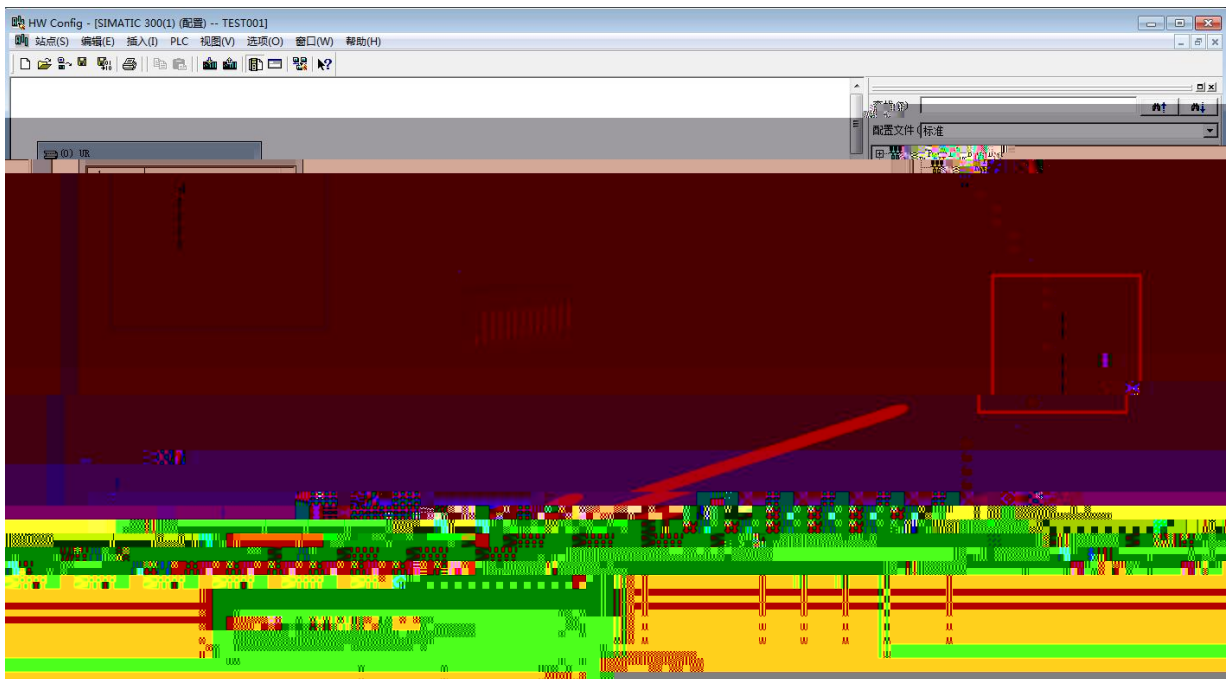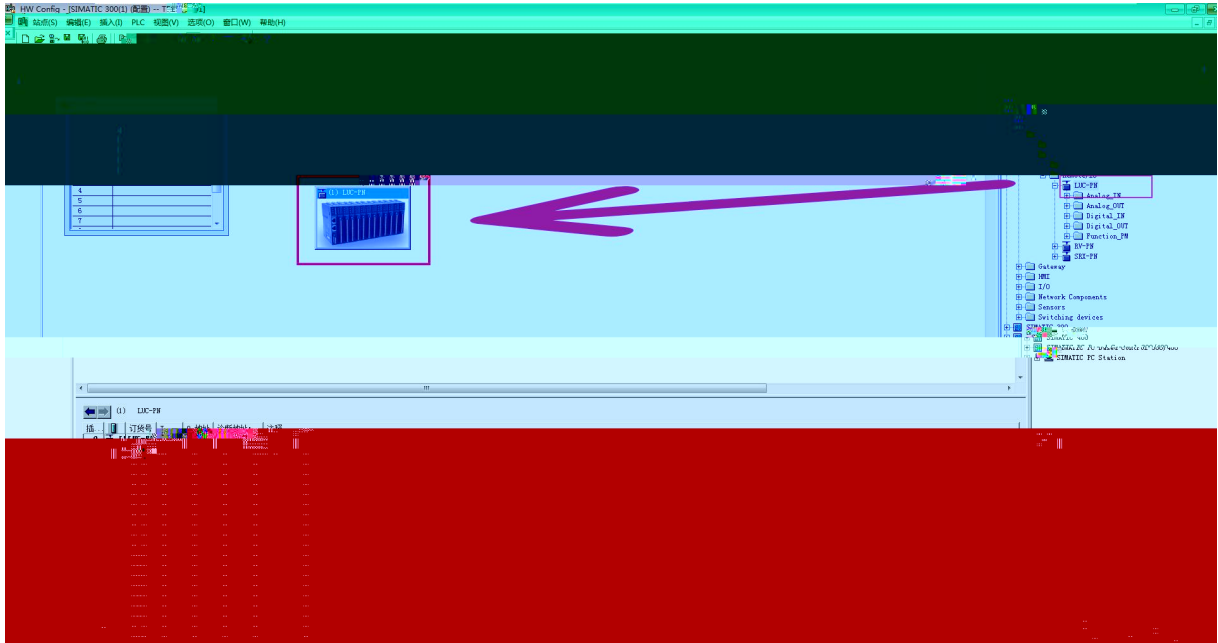

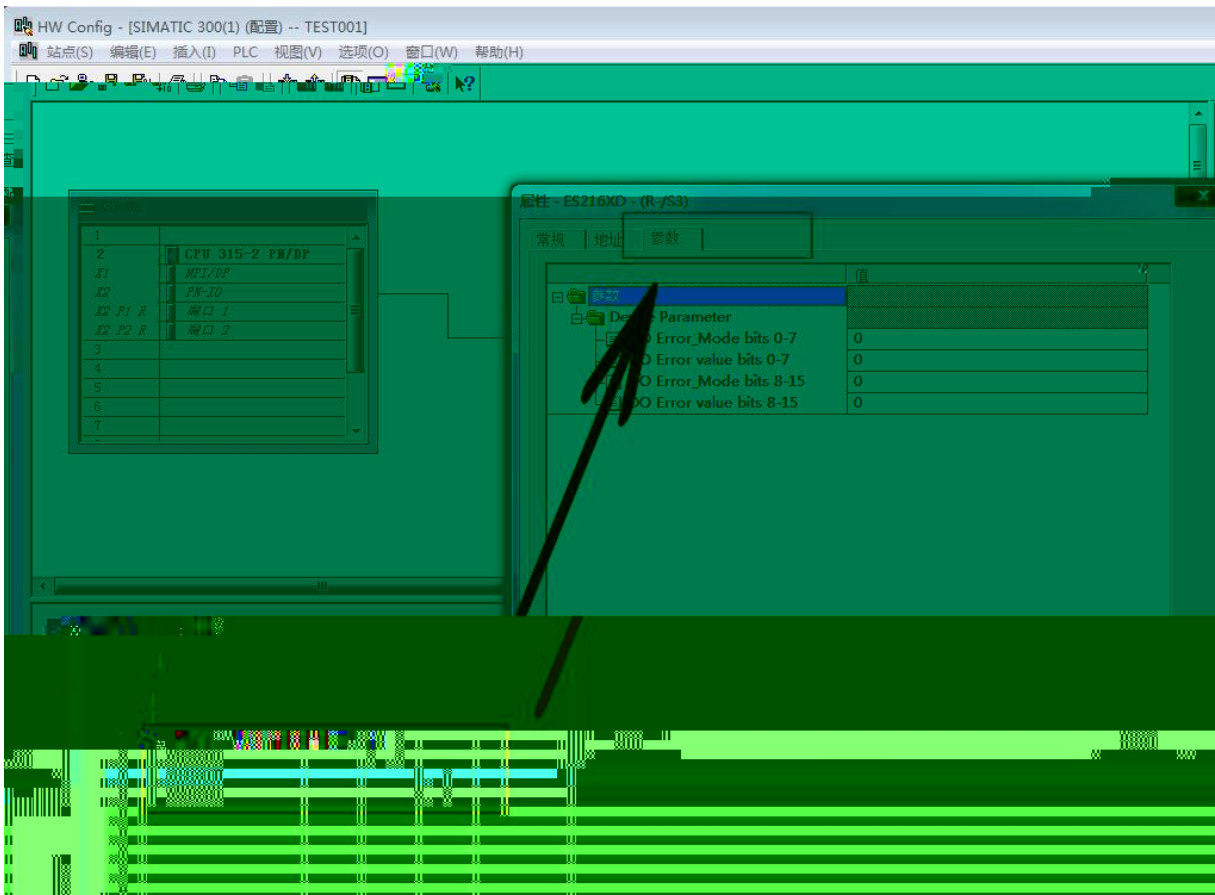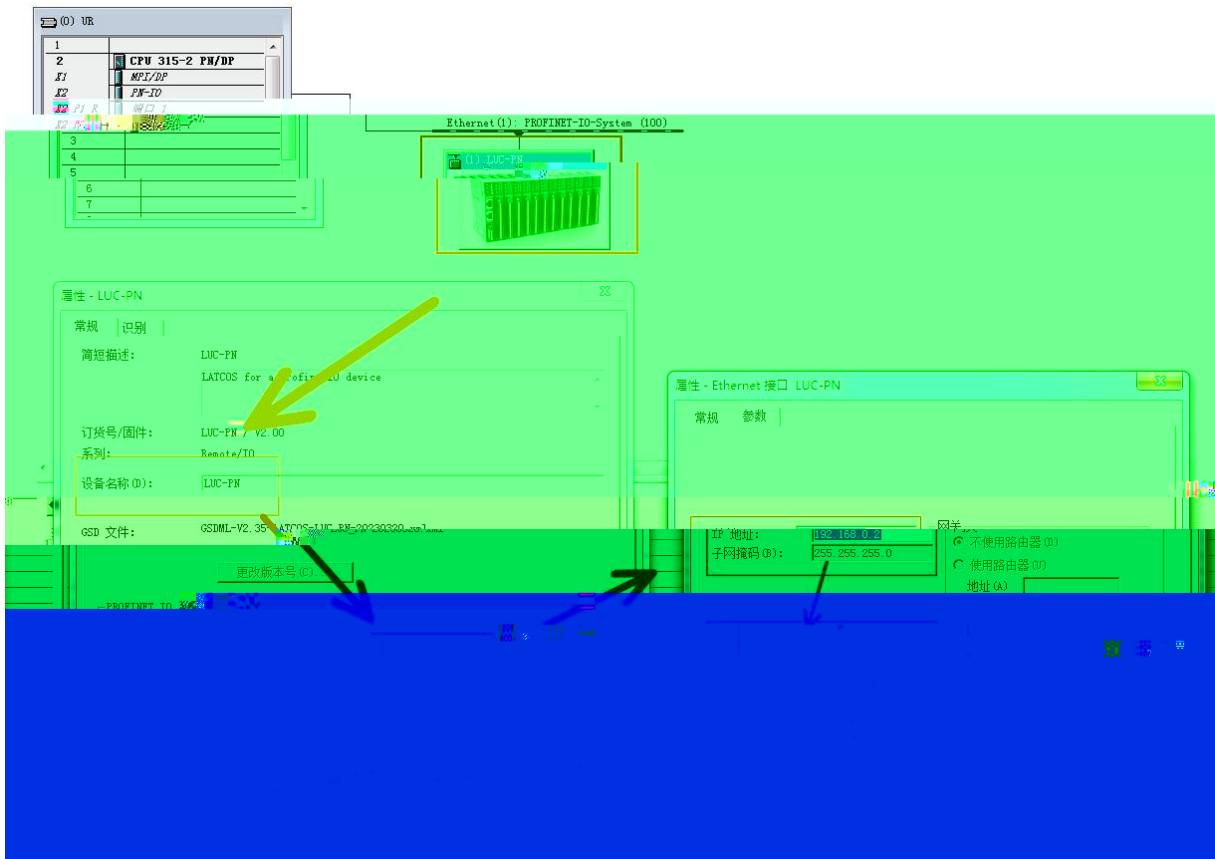




STEP7

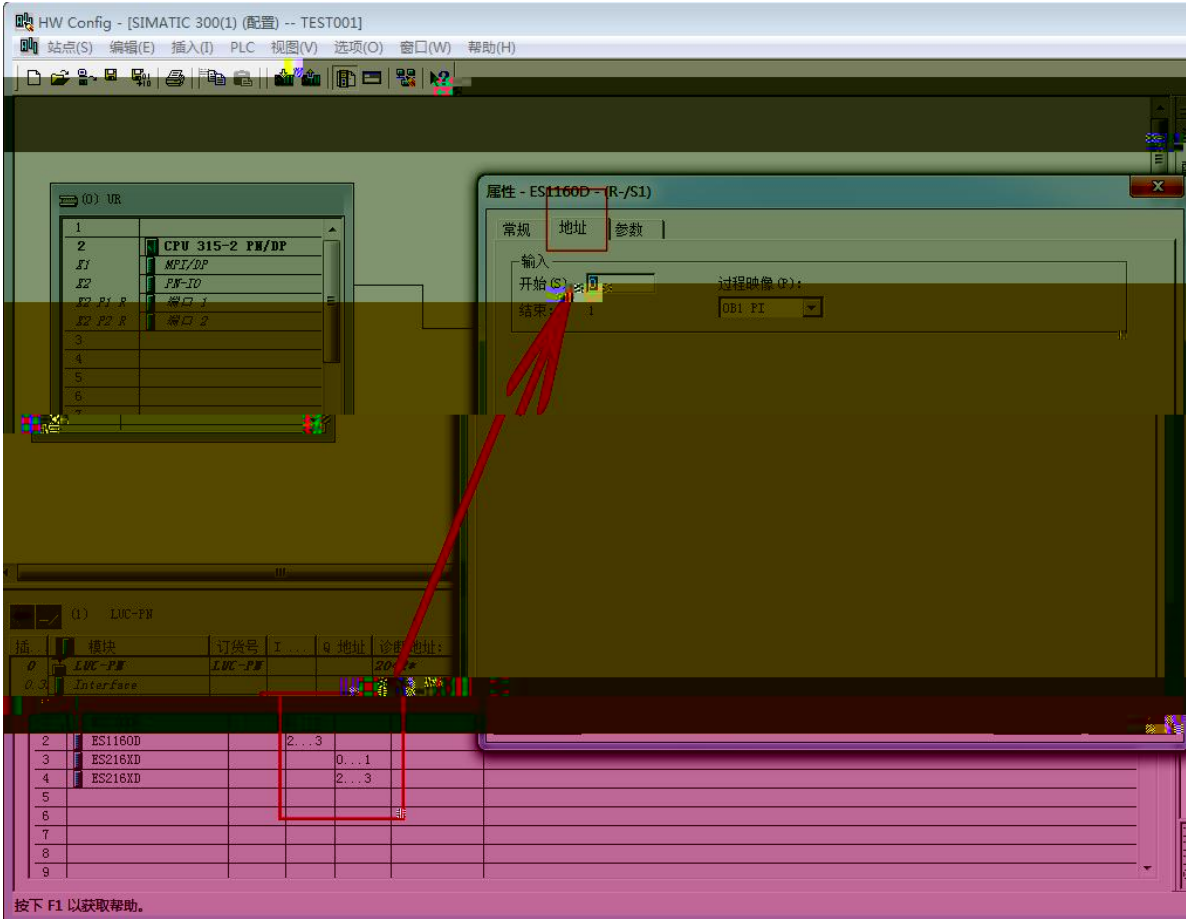

6.


IO

"PLC" "Ethernet" " Ethernet "

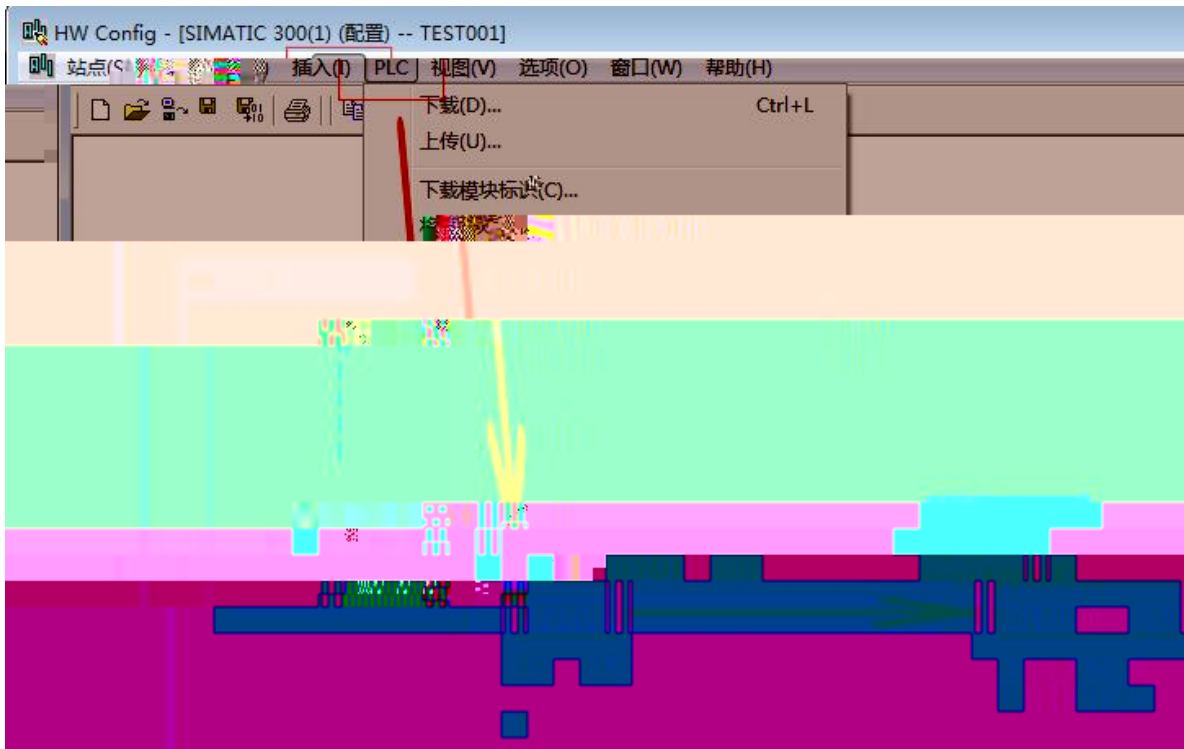

Ethernet

MAC

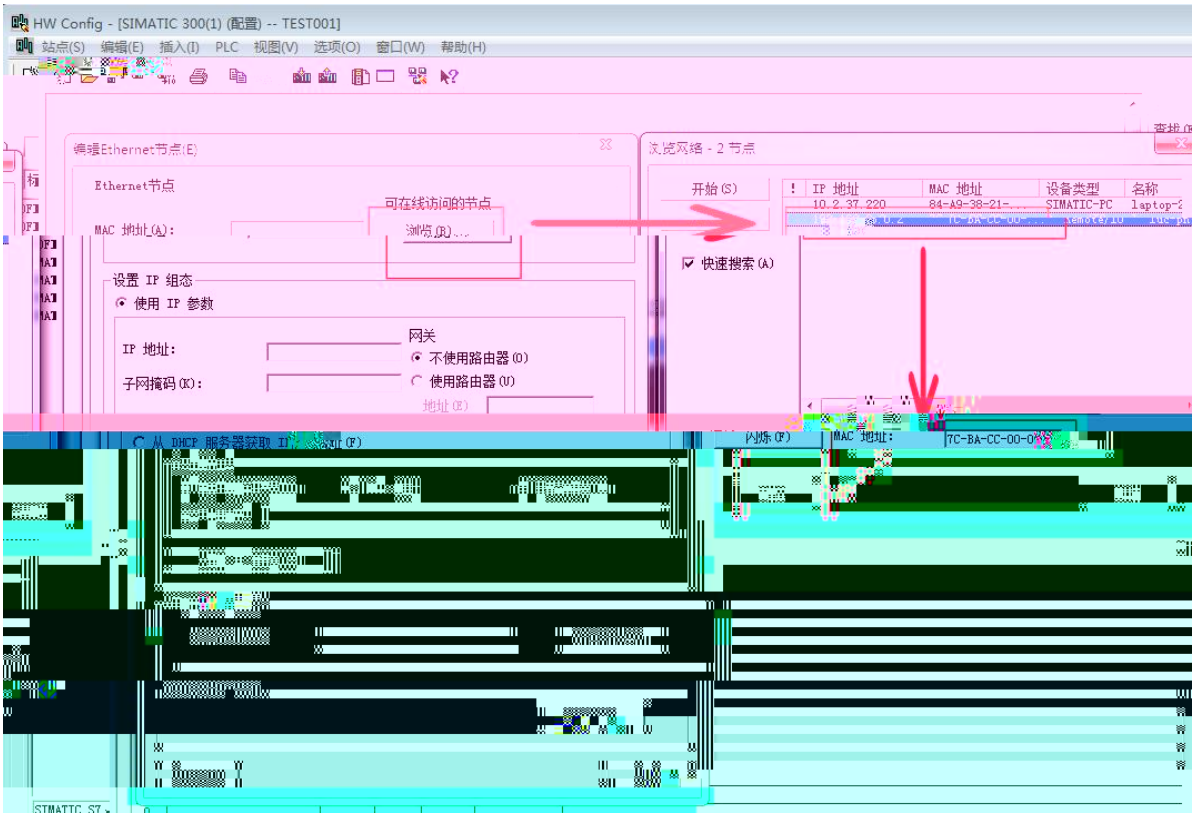

PLC

IP

