

透科自动化

SRX-PN

S7-1500


PROFINET SRX-PN S7-1500



2023-01-18

2021 1 18

2023 1 18

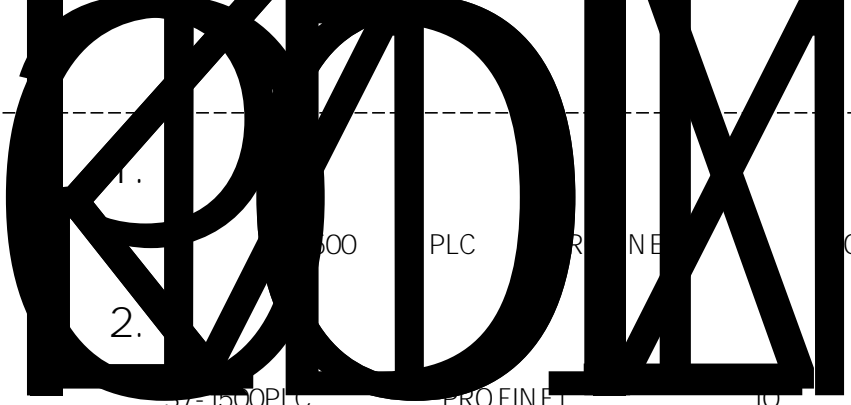

1.

500 PLC R NE 0

2.

37-1500PLC PROFINET IO IO IO


3.

- TIA Portal V14
- IO GSDML-V2.31-LATCOS-SRX_PN-20220909


4.

4.1


1.

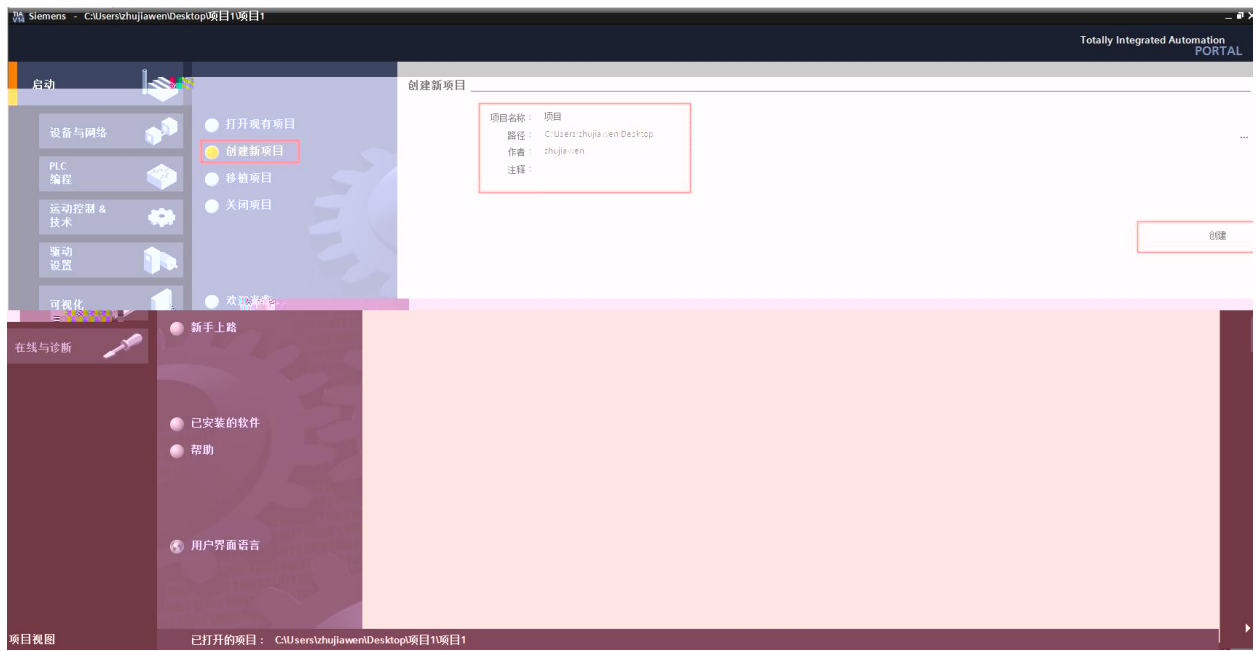

2.

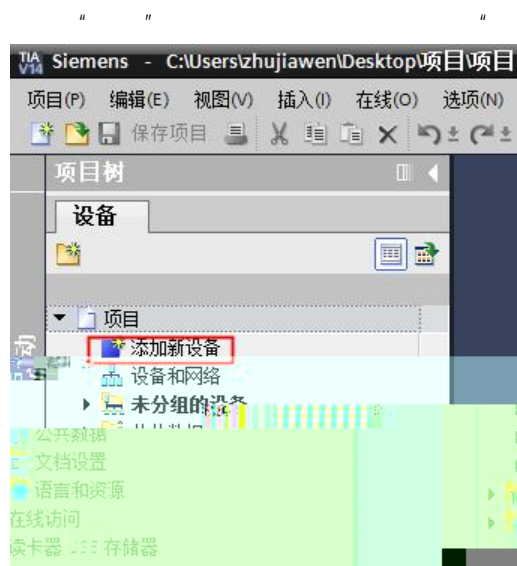

3. " " " SIMATIC S7-1500 CPU CPU 1511T-1 PN 6ES7 511-1TK01-OA B0"

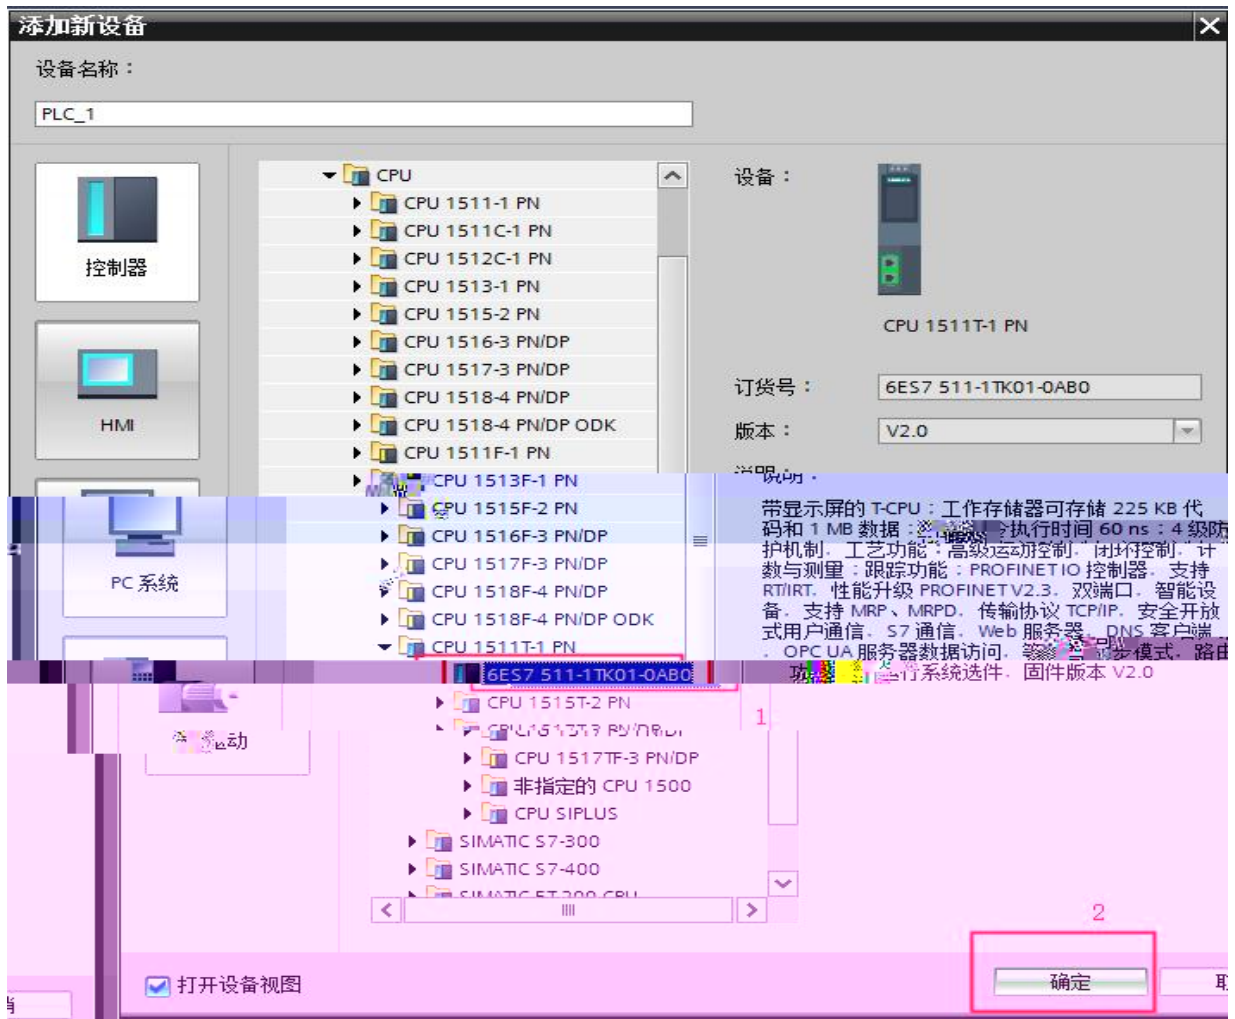


4. " " " GSD "



5.

" "

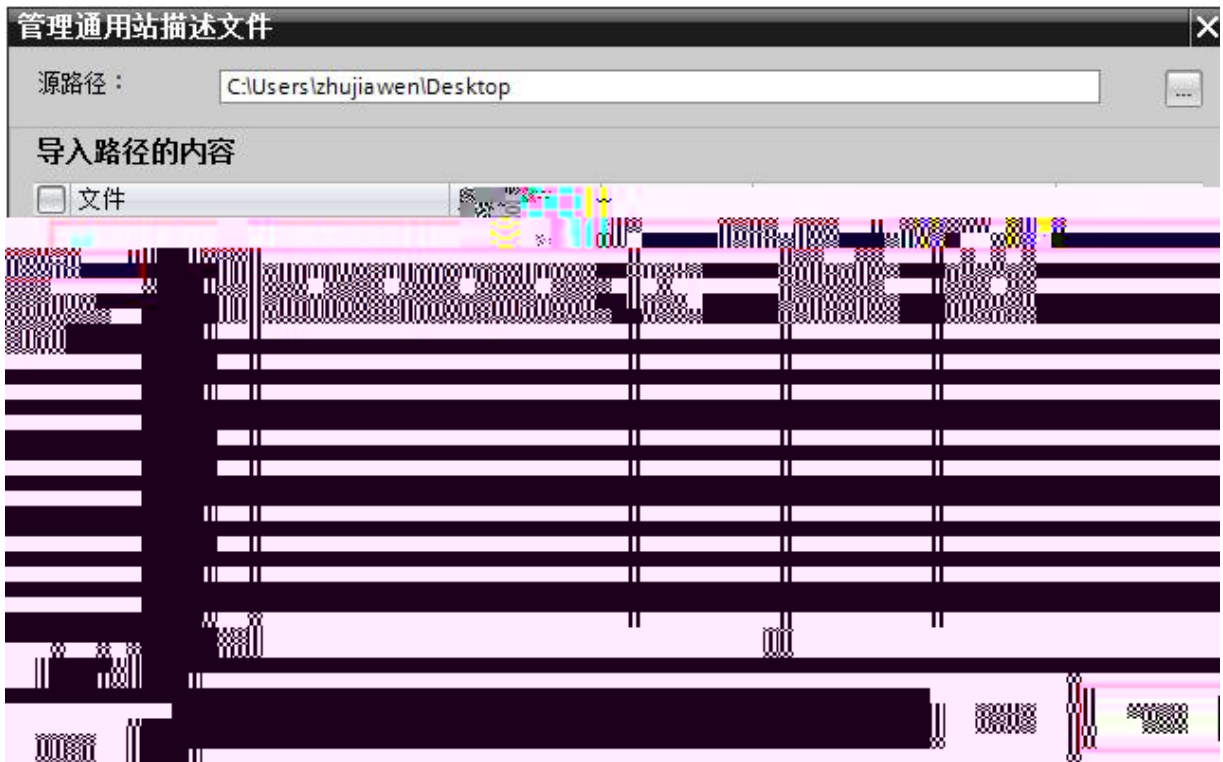


6.

" "



"SRX-PN"

IP

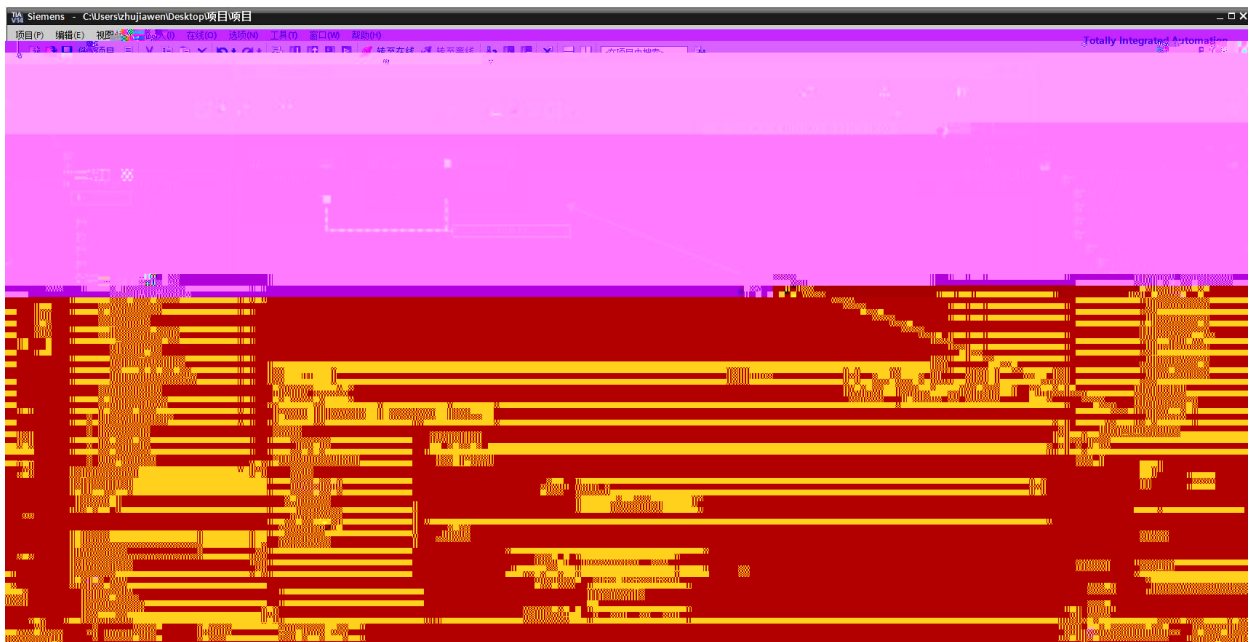

SRX-PN

| | | | | |
|----------------|-------|---------------|-------|---------------|
| SRX-D 1600P-PN | Slot1 | Input 2 byte | | |
| SRX-D 3200P-PN | Slot1 | Input 2 byte | Slot2 | Input 2 byte |
| SRX-D 1616P-PN | Slot1 | Input 2 byte | Slot2 | Output 2 byte |
| SRX-D 0016P-PN | Slot1 | Output 2 byte | | |
| SRX-D 0032P-PN | Slot1 | Output 2 byte | Slot2 | Output 2 byte |
| SRX-A 0600-PN | Slot1 | 6CH AI | | |

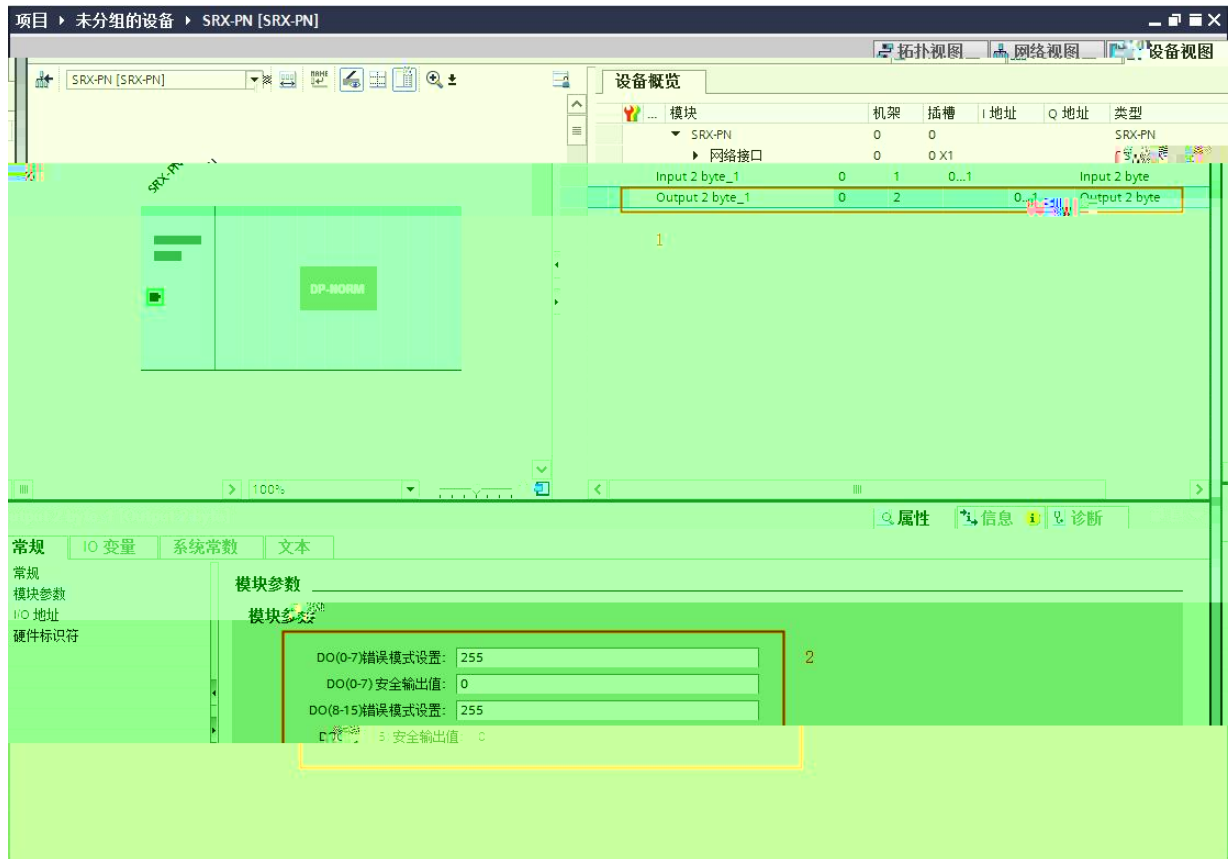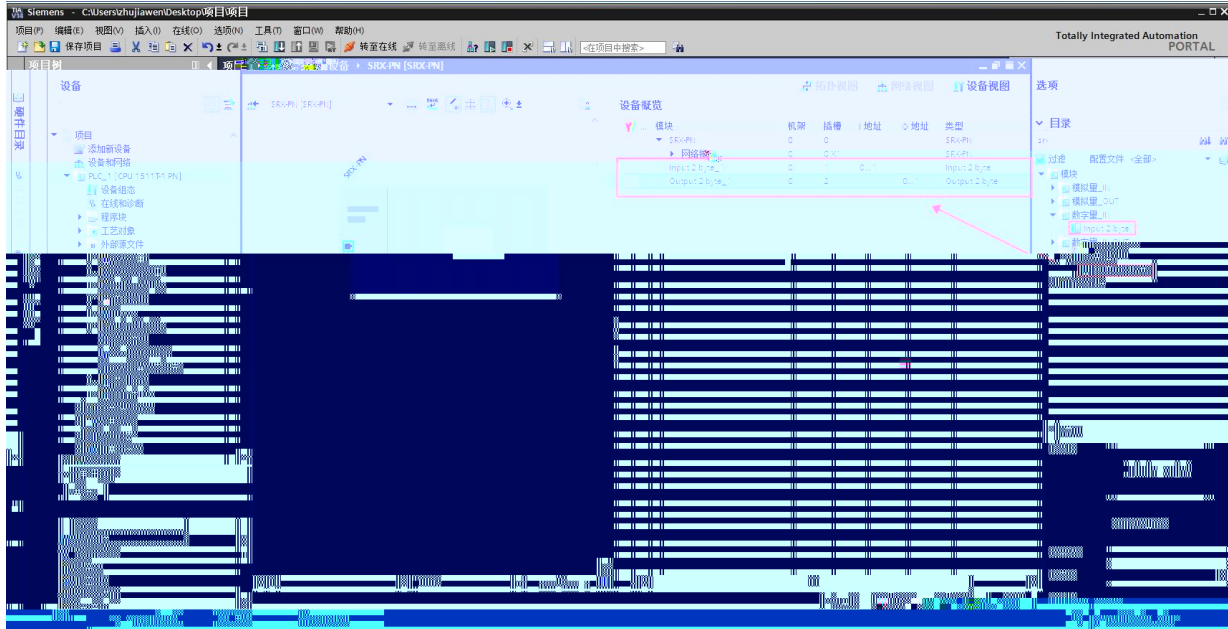


7. PROFINET

Not assigned


PLC_1.PEOPFINET interface_1

SRX-PN

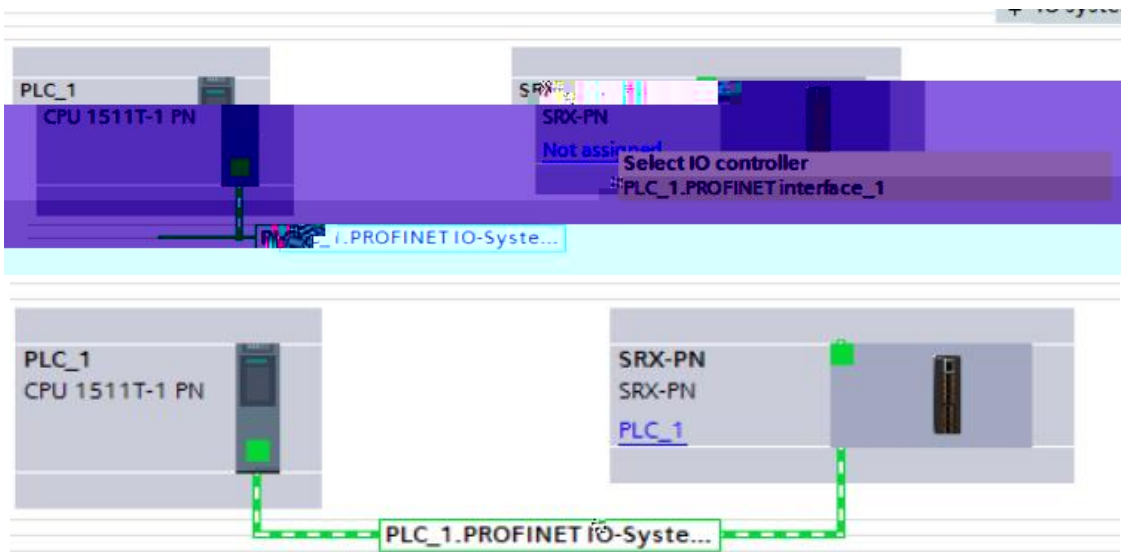


8.

S7-1500 IP

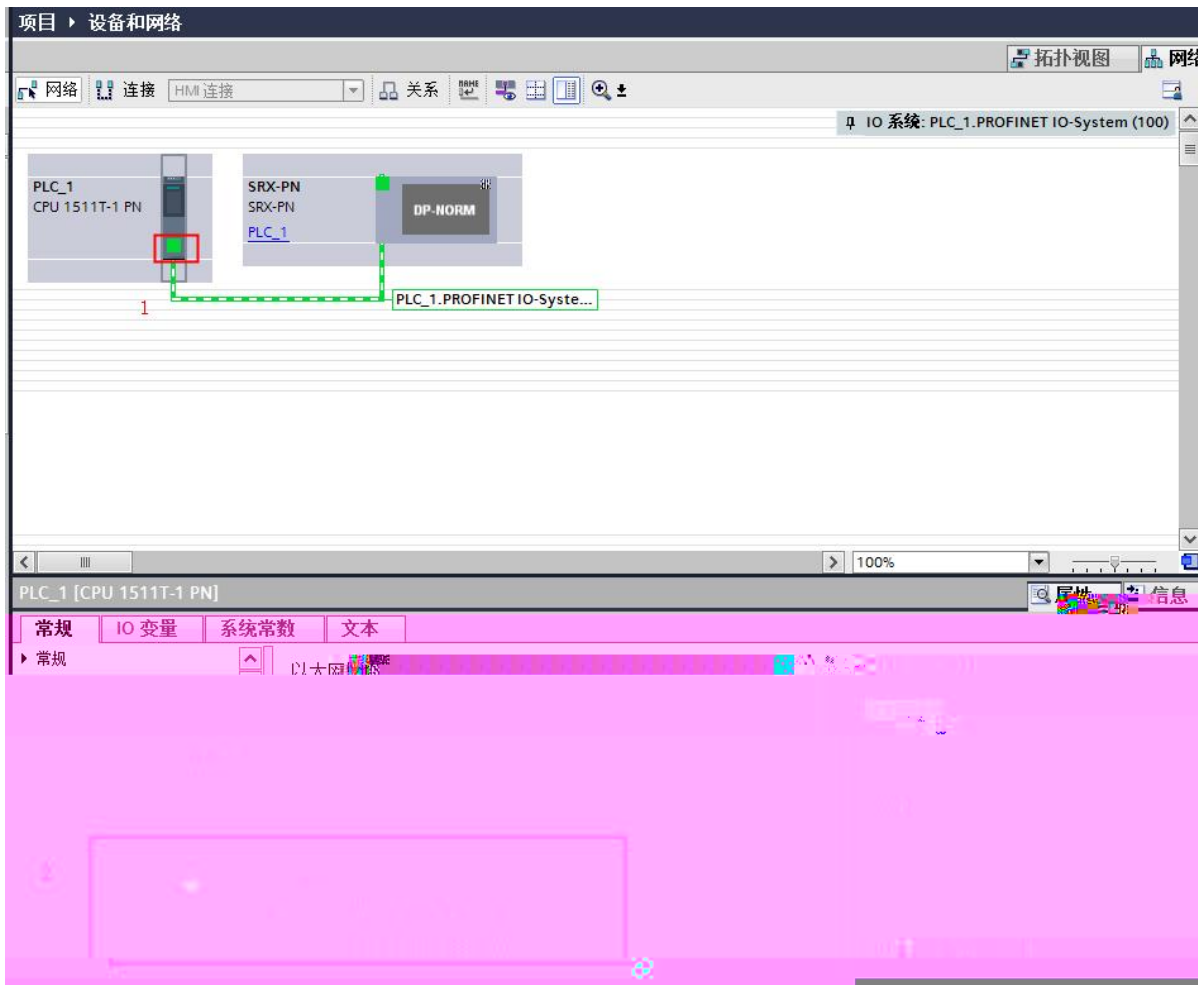

9. IO IP

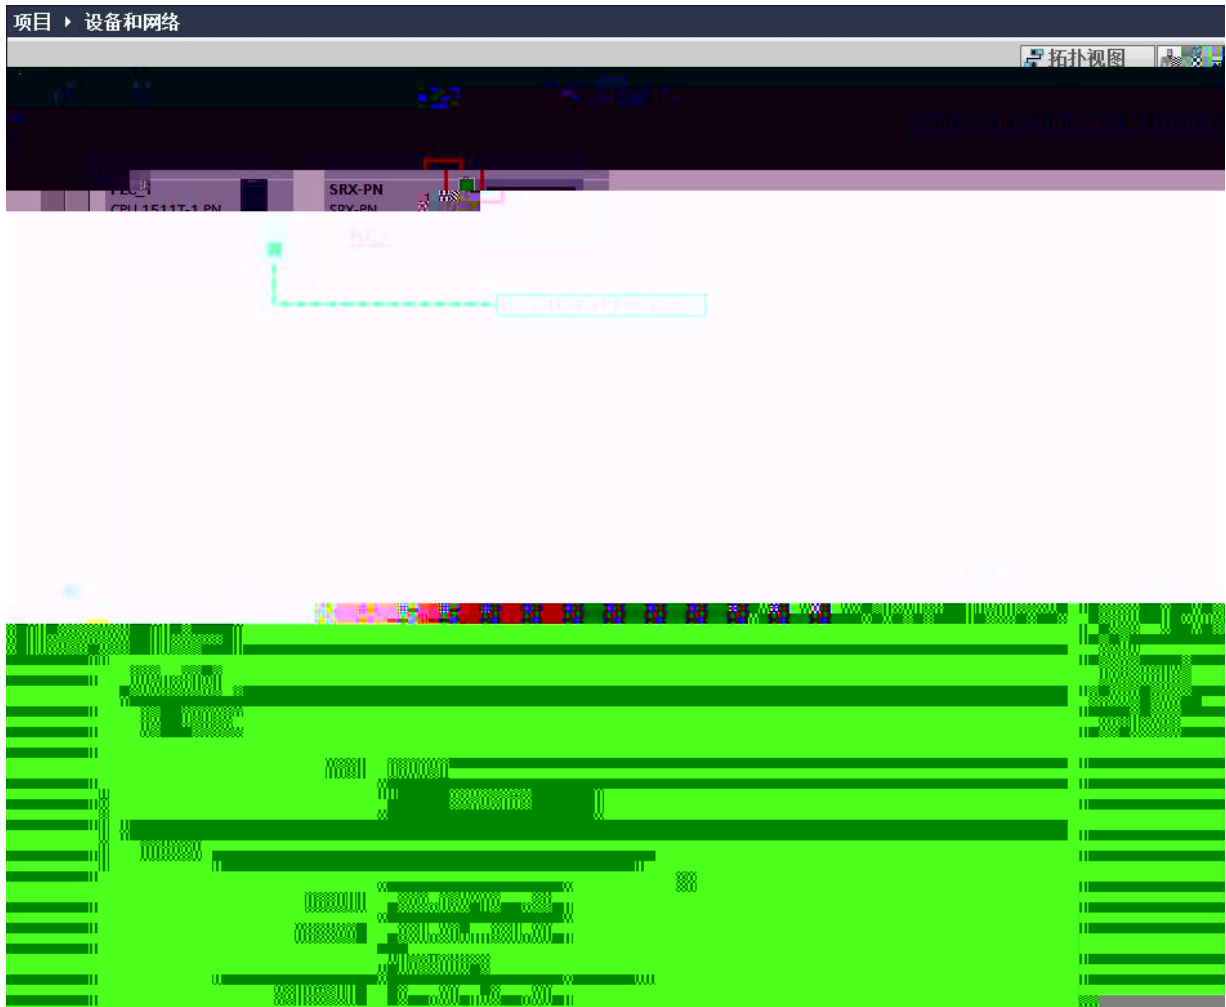

4.3

IO

IP

TIA Portal

IP

"

-

"



IP

IP

